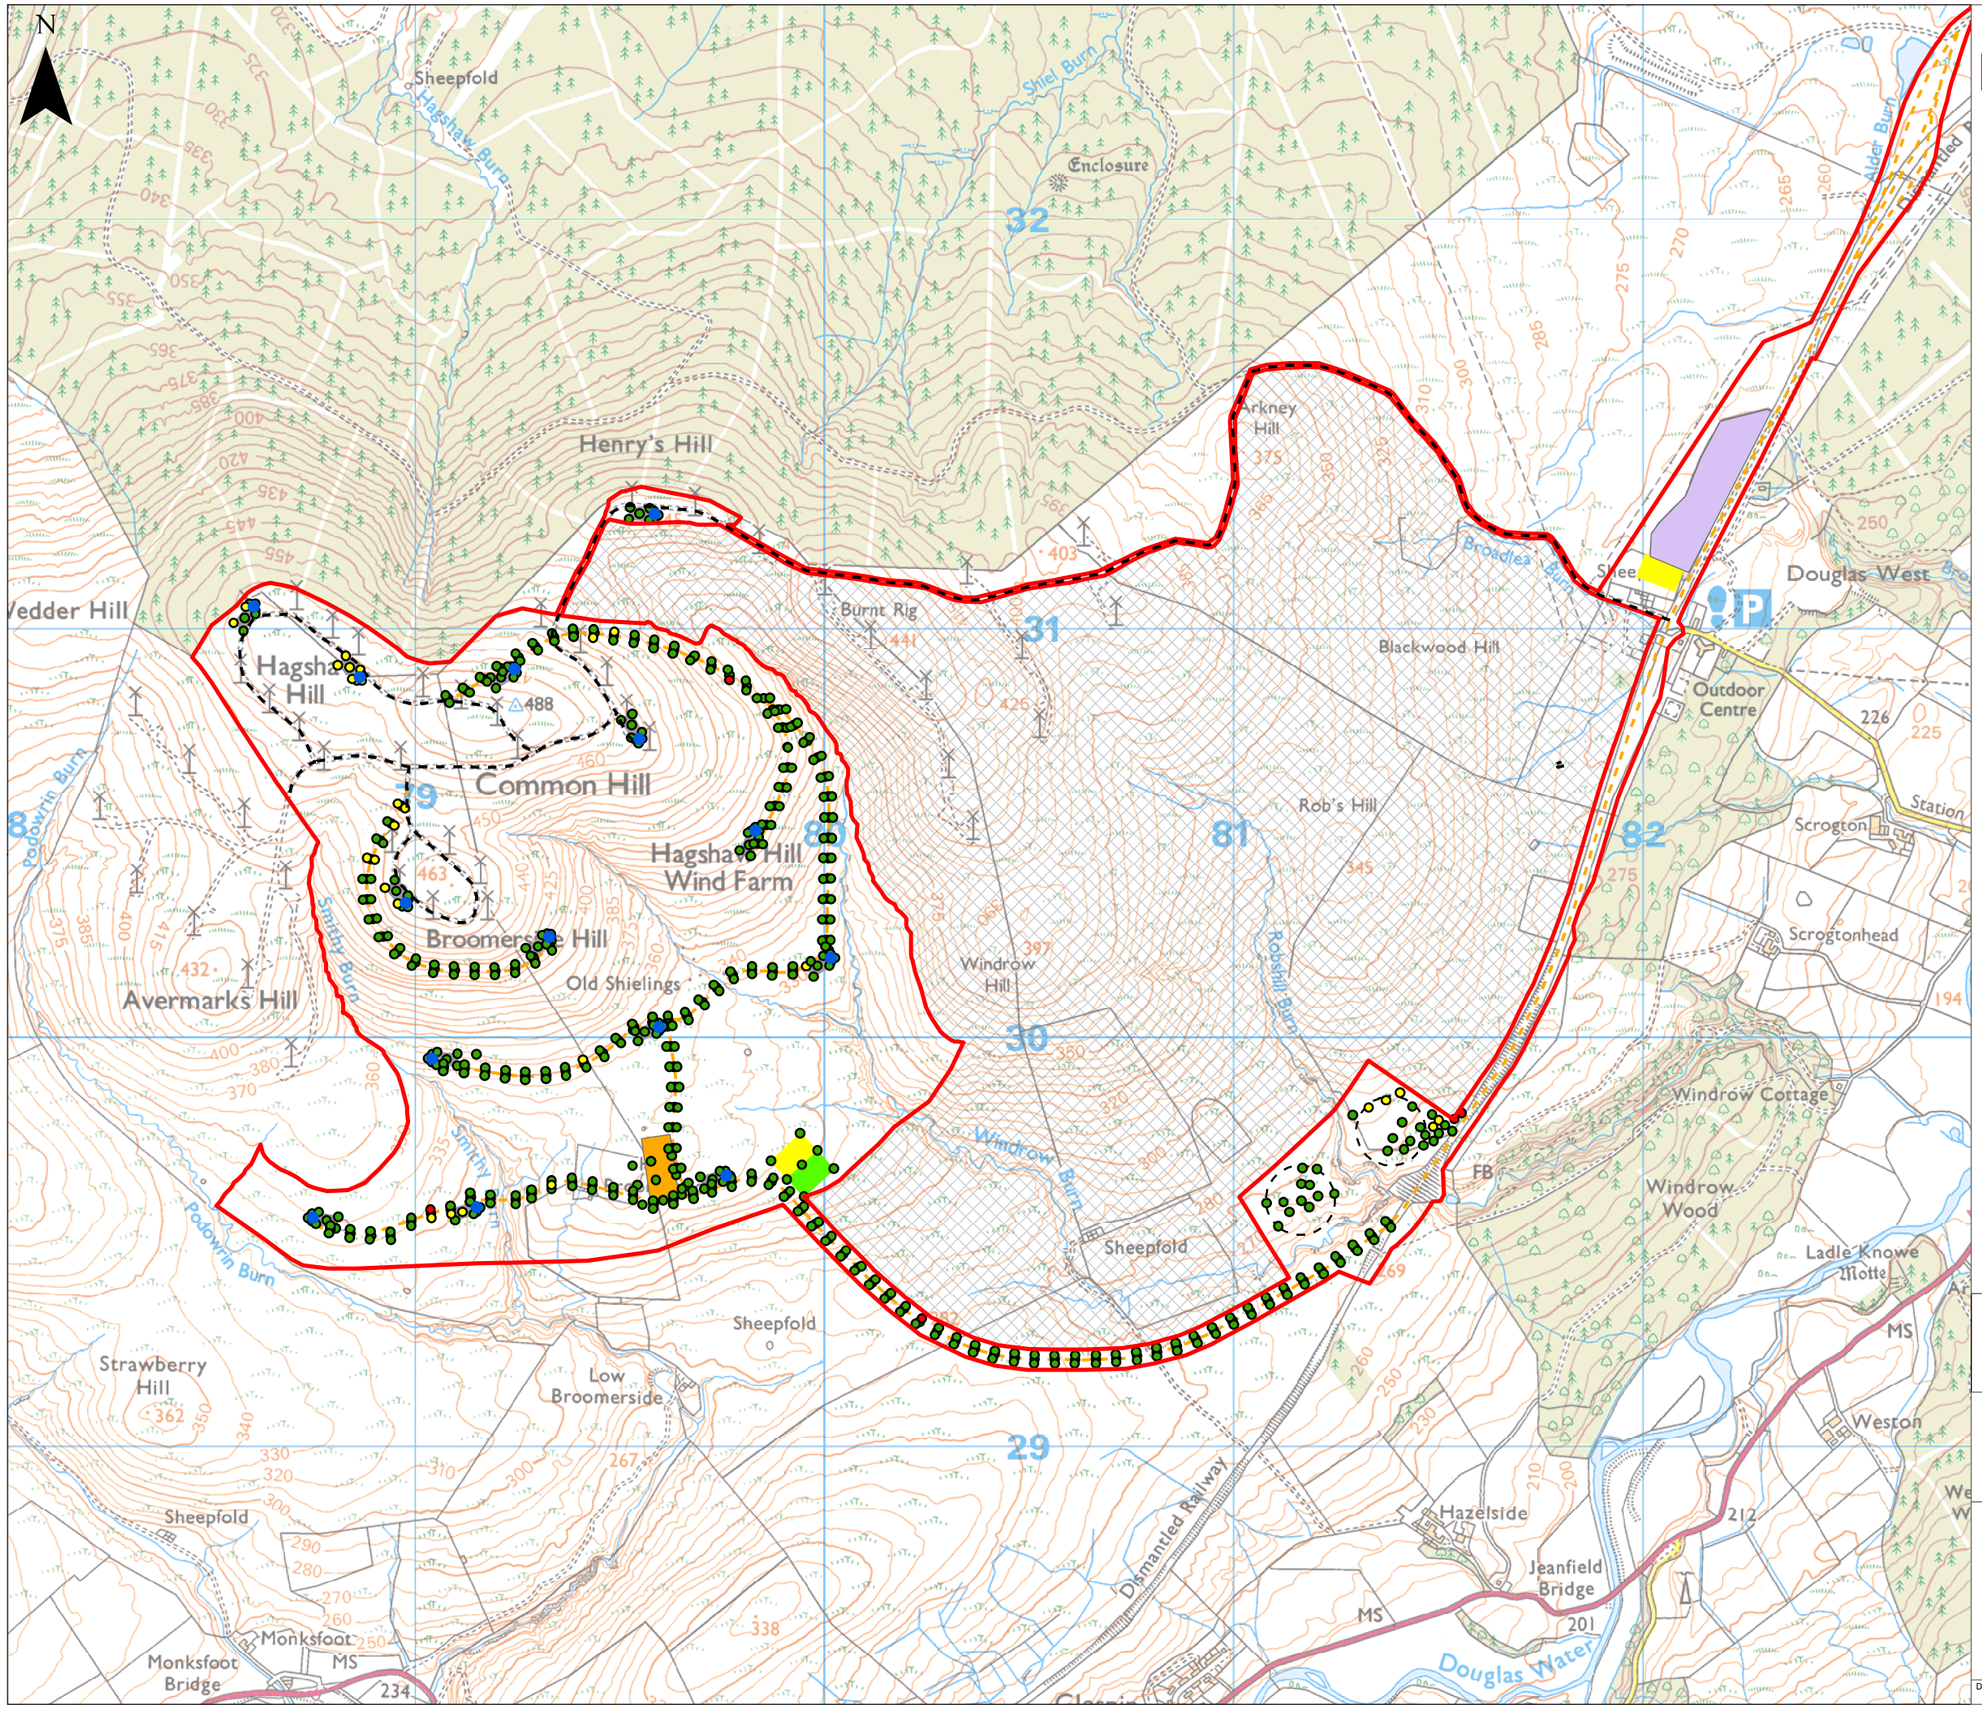

KEY

- Site Boundary
- Area Not Included in Site Boundary
- Turbine Location
- Indicative New Access Track
- Existing Development Access Track (to be retained)
- Hardstanding
- Temporary Turbine Component Laydown Area
- Substation, Control Room & Energy Storage Facility
- Temporary Construction Compound
- Existing Bing
- Borrow Pit Search Area

Peat Depth (cm)

- <50
- 50 - 100
- >100

0 0.3 0.6 km

Scale 1:15,000 @ A3

Hagshaw Hill Repowering
Environmental Impact Assessment Report

Figure 11.5

Peat Survey Locations and Depths

Date:	Drawn by:	Checked by:	Version:
07/12/2018	AR/JY	TP	V1

© Crown copyright and database rights 2018. Ordnance Survey 0100031673